


**PLAN VIEW**

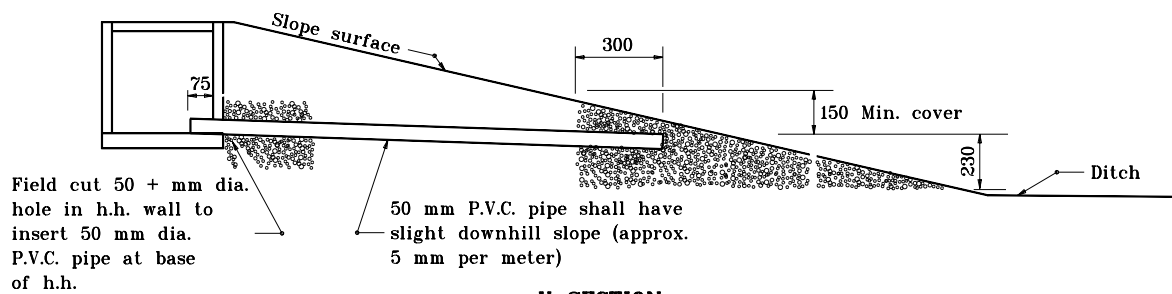


Field cut 50 + mm dia. hole in h.h. wall to insert 50 mm dia. P.V.C. pipe at base of h.h.

50 mm P.V.C. pipe shall have slight downhill slope (approx. 5 mm per meter)

**X-SECTION**

**HANDHOLE DRAIN DETAIL**

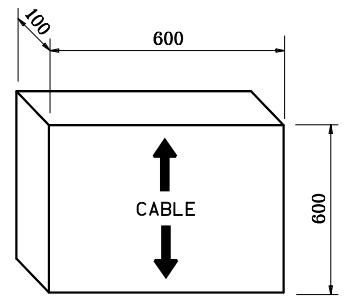

**CABLE MARKER**

All dimensions are in mm unless otherwise specified.

INDIANA DEPARTMENT OF TRANSPORTATION	
<b>LIGHT HANDHOLE DRAIN &amp; CABLE MARKER</b>	
MARCH 1995	
STANDARD DRAWING NO. <b>807-LTHH-03</b>	
	/s/ Anthony L. Uremovich 3-01-95 DESIGN STANDARDS ENGINEER DATE
	/s/ Donald W. Lucas 3-01-95 CHIEF HIGHWAY ENGINEER DATE

Source Sheet: **MT6F**