


INDEX	
SHEET NO.	SUBJECT
1	Curb Ramp Drawing Index and General Notes
2-3	Perpendicular Curb Ramp Typical Placement
4	Perpendicular Curb Ramp Component Details
5	One-Way-Directional Perpendicular Curb Ramp Typical Placement
6	One-Way-Directional Perpendicular Curb Ramp Component Details
7	Parallel Curb Ramps Typical Placement
8	Parallel Curb Ramp Component Details
9	Blended Transition Curb Ramp, Depressed Curb Ramp and Diagonal Curb Ramp Typical Placement
10	Blended Transition Curb Ramp Component Details
11	Median Cut-Through and Median Perpendicular Curb Ramp Typical Placement
12-13	Detectable Warning Surface Placement and Configuration
14	Detectable Warning Surface Details

GENERAL NOTES:

- All slopes are absolute rather than relative to the sidewalk or roadway grade. Slopes at least 0.50% less than the maximum are preferred.
- Ramp or Blended Transition. A ramp or blended transition shall be used to lower or raise the sidewalk to connect with the street or highway.
- Turning Space. A turning space shall be provided at the top of a perpendicular ramp, bottom of a parallel ramp, or where the pedestrian travel requires a change in direction. A common turning space may be shared by adjacent ramps. The turning space shall have a minimum clear dimension of 4 ft x 4 ft. Where the turning space is constrained at the back of the sidewalk by a curb, retaining wall, building, or feature over 2 Inches in height, the minimum clear dimension shall be 4 ft x 5 ft, with the 5-ft dimension in the direction of the ramp running slope.
- Flared Side. A flared side shall be used adjacent to a walkable surface. A flared side may be used adjacent to a non-walkable surface. A flared side shall have a maximum slope of 10.00% measured parallel to the back of the curb.
- Return Curb. A return curb is placed perpendicular to the roadway curb. A return curb may be used adjacent to a non-walkable surface. A return curb shall not be used adjacent to a walkable surface.
- Clear Space. A clear space shall be provided beyond the bottom grade break of a curb ramp wholly contained within the crosswalk and wholly outside the parallel vehicular travel path. The clear space shall have a minimum clear dimension of 4 ft x 4 ft.
- Detectable Warning Surface. A detectable warning surface shall be placed at each street, highway, or railroad crossing. A detectable warning surface shall extend a minimum of 2 ft in the direction of pedestrian travel and be placed the entire width of a ramp, blended transition, or turning space.
 - A running slope of 2.00% or less is considered level.
 - A ramp shall have a maximum running slope of 8.33% but shall not require a ramp length to exceed 15 ft.
 - A blended transition shall have a maximum running slope of 5.00%.
 - A turning space shall have a maximum running slope of 2.00%.
- Width. Unless otherwise noted, minimum width of a ramp, blended transition, or turning space, excluding flared sides or return curb, shall be 4 ft.
- Grade Break. A grade break at the top and bottom of a ramp, blended transition, or turning space shall be perpendicular to the running slope. Grade breaks shall not be within the ramp, blended transition, turning space, or detectable warning surface. Grade breaks shall be flush. Vertical discontinuities shall not be greater than 1/2 In. Where a discontinuity is greater than 1/4 In. the surface shall be beveled with a slope not steeper than 1V:2H.
- Cross Slope Exceptions. The cross slope of a ramp, blended transition, or turning space shall be measured perpendicular to the direction of pedestrian travel.
 - The maximum cross slope at a pedestrian street crossing without yield or stop control shall be 5.00%.
 - The maximum cross slope at a pedestrian street crossing with yield or stop control shall be 2.00%.
 - The maximum cross slope at a midblock crossing shall be the established grade of the adjacent roadway.
- Objects such as a utility cover, vault frame, and grating shall be placed outside the curb ramp.
- Curb ramps shall be placed within the marked crosswalk area.
- Drainage inlets should be located uphill from a curb ramp to prevent ponding in the path of pedestrian travel.

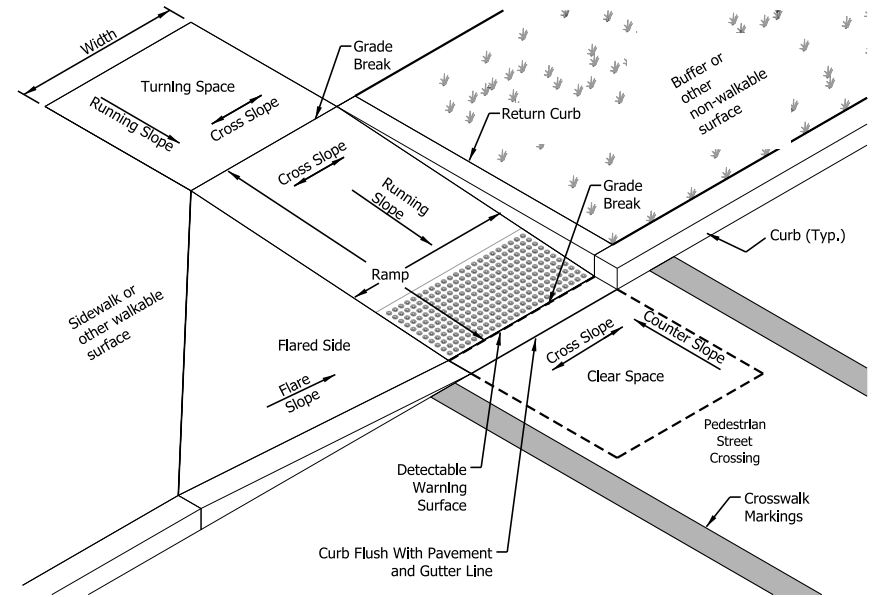


INDIANA DEPARTMENT OF TRANSPORTATION

CURB RAMP DRAWING INDEX
AND GENERAL NOTES


SEPTEMBER 2016

STANDARD DRAWING NO. E 604-SWCR-01




/s/ Elizabeth W. Phillips 03/15/16
DESIGN STANDARDS ENGINEER DATE


/s/ Mark A. Miller 03/18/16
CHIEF ENGINEER DATE

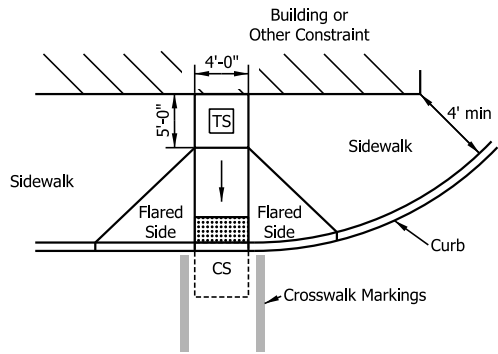

PERPENDICULAR CURB RAMP
ADJACENT WALKABLE SURFACE

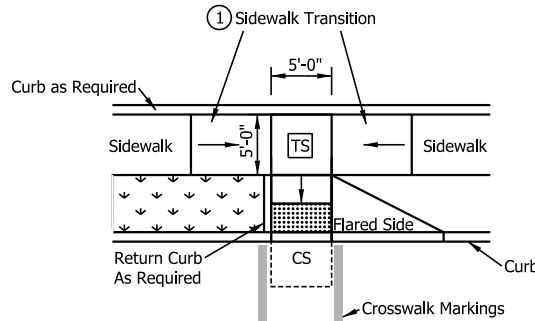

TIERED PERPENDICULAR CURB RAMP

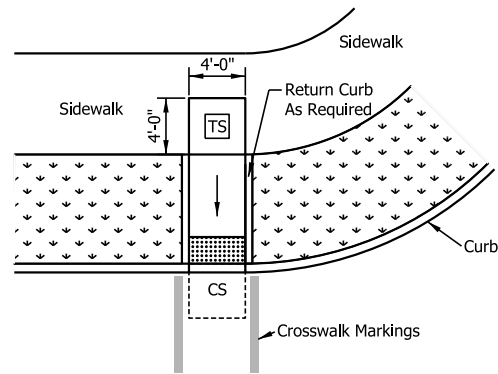

PERPENDICULAR CURB RAMP
ADJACENT NON-WALKABLE SURFACE

NOTES:

- ① Where insufficient width between the curb and back of sidewalk prevent a standard perpendicular curb ramp running slope, a sidewalk transition may be used to lower the sidewalk grade. The sidewalk transition running slope shall not exceed 8.33%.
2. The turning space shall have a minimum clear dimension of 4 ft x 4 ft. Where the turning space is constrained at the back of the sidewalk, the minimum clear dimension shall be 4 ft x 5 ft, with the 5-ft dimension in the direction of the ramp running slope. Where a tiered perpendicular curb ramp is used, a constrained turning space shall have a minimum clear dimension of 5 ft x 5 ft.

LEGEND:


- Buffer or Other Non-Walkable Surface
- Ramp
- Detectable Warning Surface
- Turning Space
- Clear Space

INDIANA DEPARTMENT OF TRANSPORTATION

PERPENDICULAR CURB RAMP
TYPICAL PLACEMENT


SEPTEMBER 2016

STANDARD DRAWING NO. E 604-SWCR-02




/s/ Elizabeth W. Phillips 03/15/16
DESIGN STANDARDS ENGINEER DATE

/s/ Mark A. Miller 03/18/16
CHIEF ENGINEER DATE

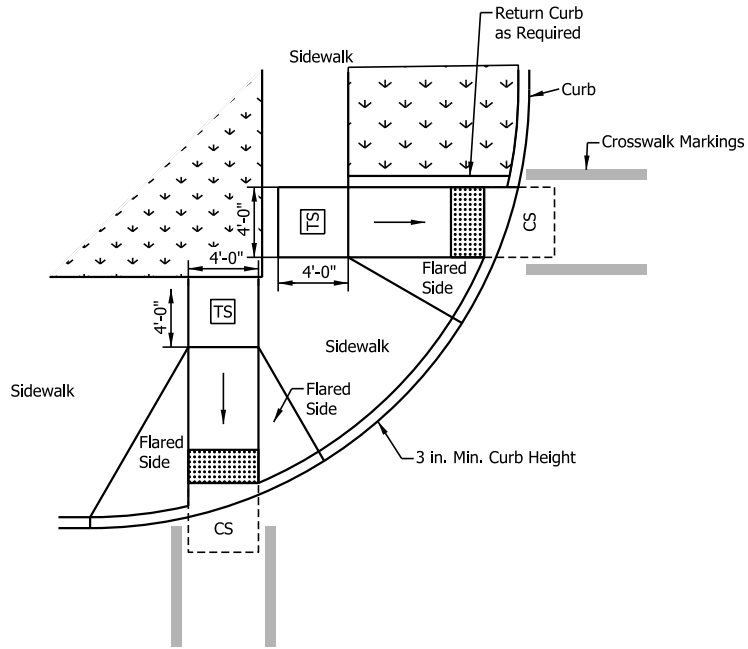

PAIRED PERPENDICULAR CURB RAMPS AT LARGE RADIUS

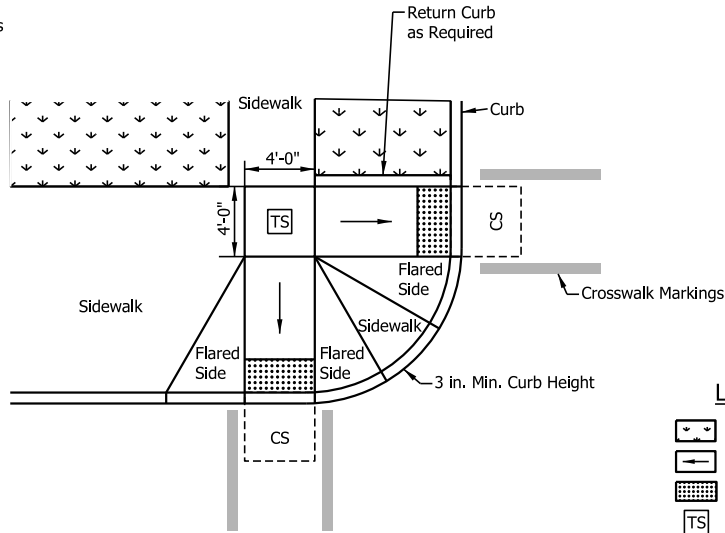






PAIRED PERPENDICULAR CURB RAMPS AT SMALL RADIUS

NOTES:

1. The turning space shall have a minimum clear dimension of 4 ft x 4 ft and a running slope of 2.00% maximum. Where the turning space is constrained at the back of the sidewalk, the minimum clear dimension shall be 4 ft x 5 ft, with the 5-ft dimension in the direction of the ramp running slope.

LEGEND:


-  Buffer or Other Non-Walkable Surface
-  Ramp
-  Detectable Warning Surface
-  Turning Space
-  Clear Space

INDIANA DEPARTMENT OF TRANSPORTATION

PAIRED PERPENDICULAR CURB RAMPS
TYPICAL PLACEMENT


SEPTEMBER 2016

STANDARD DRAWING NO. E 604-SWCR-03



/s/ Elizabeth W. Phillips 03/15/16
DESIGN STANDARDS ENGINEER DATE

/s/ Mark A. Miller 03/18/16
CHIEF ENGINEER DATE

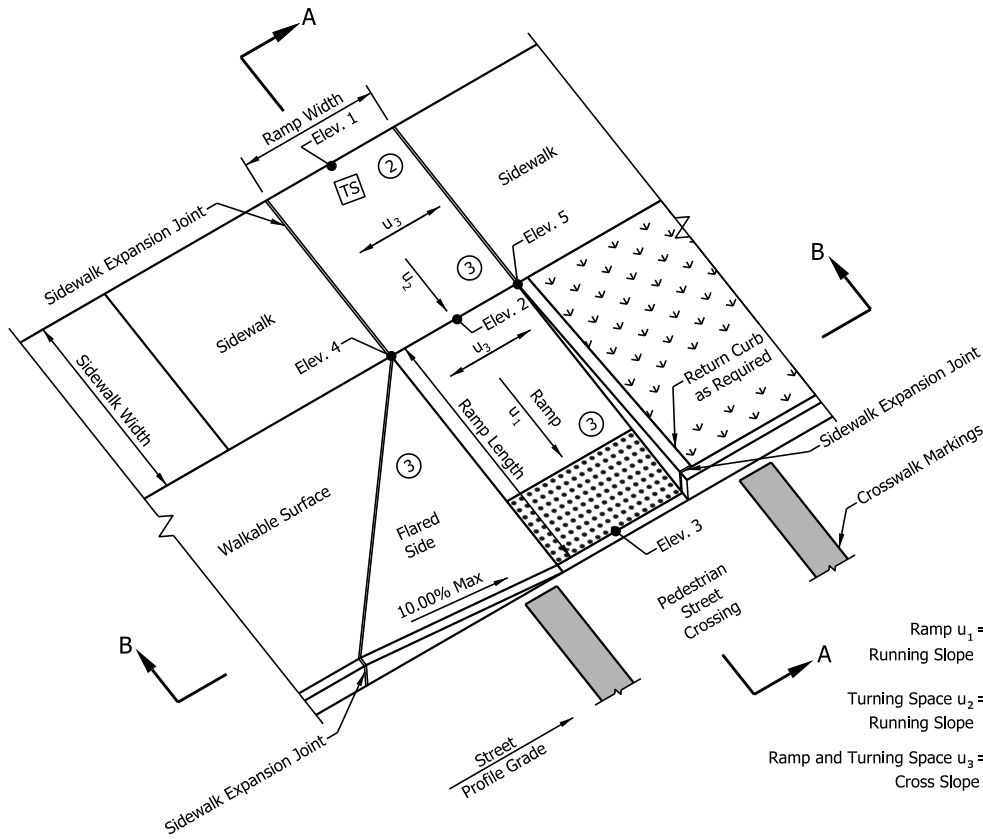

Component Slope Equations:

$$\text{Ramp } u_1 = \frac{\text{Elev. 2} - \text{Elev. 3}}{\text{Ramp Length}} \leq 8.33\%$$



Running Slope

$$\text{Turning Space } u_2 = \frac{\text{Elev. 1} - \text{Elev. 2}}{\text{Sidewalk Width}} \leq 2.00\%$$

Running Slope

$$\text{Ramp and Turning Space } u_3 = \frac{\text{Elev. 4} - \text{Elev. 5}}{\text{Ramp or Turning Space Width}} \leq 2.00\% \text{ (4)}$$

Cross Slope

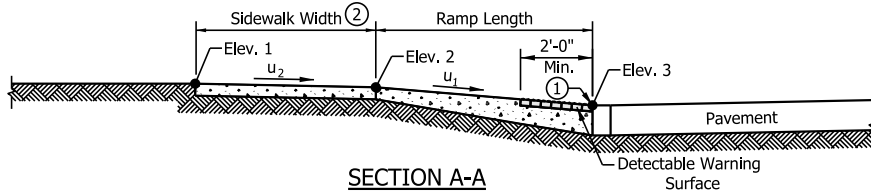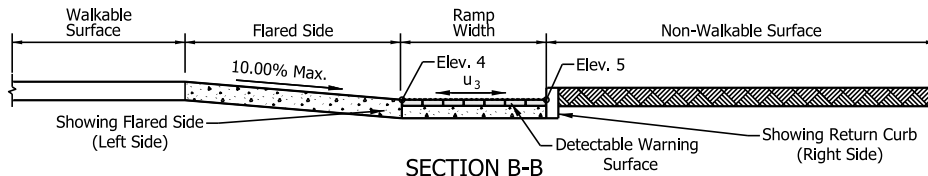

NOTES:

- ① The bottom edge of the ramp and top of curb shall be flush with the edge of adjacent pavement and gutter line.
- ② The turning space shall have a minimum clear dimension of 4 ft x 4 ft. Where the turning space is constrained at the back of the sidewalk, the minimum clear dimension shall be 4 ft x 5 ft, with the 5-ft dimension in the direction of the ramp running slope. Where a tiered perpendicular curb ramp is used, a constrained turning space shall have a minimum clear dimension of 5 ft x 5 ft.
- ③ Curb ramp surface shall be coarse broomed transverse to the running slope.
- ④ See Standard Drawing E 604-SWCR-01 for cross slope exceptions.
5. See Standard Drawing E 604-SWCR-12, -13, and -14 for Detectable Warning Surface placement, configuration, and details.
6. See Standard Drawing E 604-CCSJ-01 for sidewalk expansion joint details.

LEGEND:


- Buffer or Other Non-Walkable Surface
- Ramp
- Detectable Warning Surface
- Turning Space

INDIANA DEPARTMENT OF TRANSPORTATION

PERPENDICULAR CURB RAMP
COMPONENT DETAILS


SEPTEMBER 2016

STANDARD DRAWING NO. E 604-SWCR-04




/s/ Elizabeth W. Phillips 03/15/16
DESIGN STANDARDS ENGINEER DATE

/s/ Mark A. Miller 03/18/16
CHIEF ENGINEER DATE

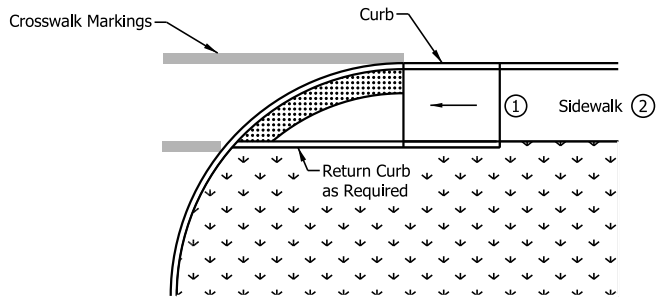

ONE-WAY DIRECTIONAL PERPENDICULAR CURB RAMP ADJACENT CURB

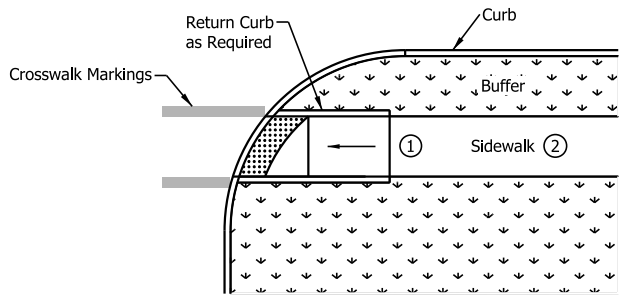

ONE-WAY DIRECTIONAL PERPENDICULAR CURB RAMP WITH BUFFER

NOTES:

- ① A turning space is not required at the top of the ramp for a one-way directional perpendicular curb ramp.
- ② Where there is no buffer between the sidewalk and curb the preferred minimum sidewalk width is 6 ft. Where a buffer is placed between the sidewalk and curb, the preferred minimum sidewalk width is 5 ft. See Standard Drawing Series E 604-SDWK for sidewalk details.


LEGEND:

- Buffer or Other Non-Walkable Surface
- Ramp
- Detectable Warning Surface

INDIANA DEPARTMENT OF TRANSPORTATION


ONE-WAY DIRECTIONAL
PERPENDICULAR CURB RAMP
TYPICAL PLACEMENT
SEPTEMBER 2016

STANDARD DRAWING NO. E 604-SWCR-05



/s/ Elizabeth W. Phillips 03/15/16
DESIGN STANDARDS ENGINEER DATE

/s/ Mark A. Miller 03/18/16
CHIEF ENGINEER DATE

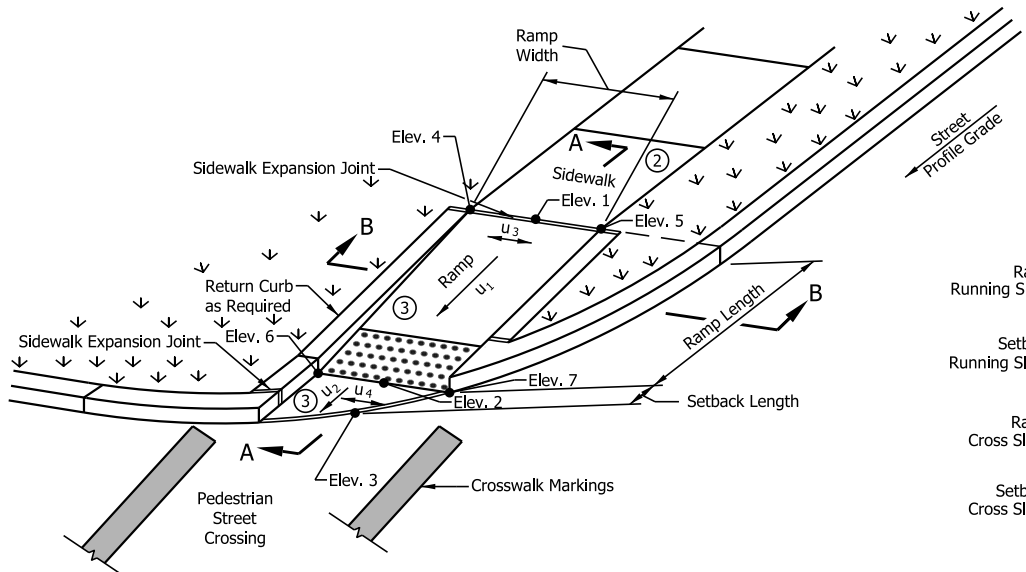


Component Slope Equations:

$$\text{Ramp } u_1 = \frac{| \text{Elev. 1} - \text{Elev. 2} |}{\text{Ramp Length}} \leq 8.33\%$$


$$\text{Setback } u_2 = \frac{| \text{Elev. 2} - \text{Elev. 3} |}{\text{Setback Length}} \leq \text{Profile Grade of Adjacent Street}$$

$$\text{Ramp } u_3 = \frac{| \text{Elev. 4} - \text{Elev. 5} |}{\text{Ramp Width}} \leq 2.00\% \text{ (4)}$$

$$\text{Setback } u_4 = \frac{| \text{Elev. 6} - \text{Elev. 7} |}{\text{Ramp Width}} \leq 2.00\% \text{ (4)}$$

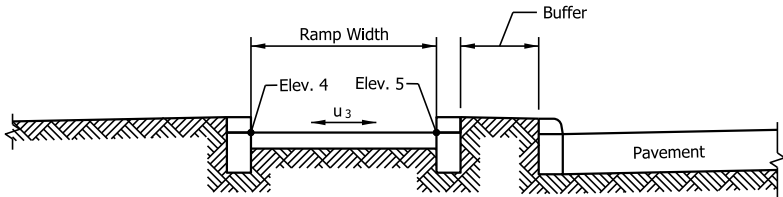

SECTION B-B

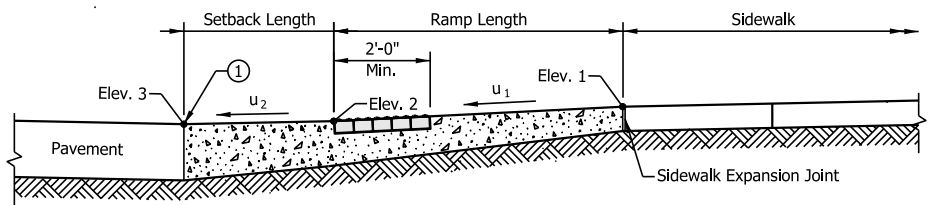

SECTION A-A

NOTES:

- ① The bottom edge of the ramp or setback and top of curb shall be flush with the edge of adjacent pavement and gutter line.
- ② A turning space is not required at the top of the ramp for a one-way directional perpendicular curb ramp.
- ③ Curb ramp surface shall be coarse broomed transverse to the running slope.
- ④ See Standard Drawing E 604-SWCR-01 for cross slope exceptions.
5. See Standard Drawing E 604-SWCR-12, -13, and -14 for Detectable Warning Surface placement, configuration, and details.
6. See Standard Drawing E 604-CCS3-01 for sidewalk expansion joint details.


LEGEND:

- Buffer or Other Non-Walkable Surface
- Ramp
- Detectable Warning Surface


INDIANA DEPARTMENT OF TRANSPORTATION											
ONE-WAY DIRECTIONAL PERPENDICULAR CURB RAMP COMPONENT DETAILS											
SEPTEMBER 2016											
STANDARD DRAWING NO.	E 604-SWCR-06										
	<table style="width: 100%; border: none;"> <tr> <td style="border: none;"><i>/s/ Elizabeth W. Phillips</i></td> <td style="border: none; text-align: right;">03/15/16</td> </tr> <tr> <td style="border: none;">DESIGN STANDARDS ENGINEER</td> <td style="border: none; text-align: right;">DATE</td> </tr> <tr> <td colspan="2" style="border: none;"> </td> </tr> <tr> <td style="border: none;"><i>/s/ Mark A. Miller</i></td> <td style="border: none; text-align: right;">03/18/16</td> </tr> <tr> <td style="border: none;">CHIEF ENGINEER</td> <td style="border: none; text-align: right;">DATE</td> </tr> </table>	<i>/s/ Elizabeth W. Phillips</i>	03/15/16	DESIGN STANDARDS ENGINEER	DATE			<i>/s/ Mark A. Miller</i>	03/18/16	CHIEF ENGINEER	DATE
<i>/s/ Elizabeth W. Phillips</i>	03/15/16										
DESIGN STANDARDS ENGINEER	DATE										
<i>/s/ Mark A. Miller</i>	03/18/16										
CHIEF ENGINEER	DATE										

NOTES:

- ① Where there is no buffer between the sidewalk and curb the preferred minimum sidewalk width is 6 ft. Where a buffer is placed between the sidewalk and curb, the preferred minimum sidewalk width is 5 ft. See Standard Drawing Series E 604-SDWK for sidewalk details.
- 2. The turning space shall have a minimum clear dimension of 4 ft x 4 ft and a running slope of 2.00% maximum. Where the turning space is constrained at the back of the sidewalk, the minimum clear dimension shall be 4 ft x 5 ft, with the 5-ft dimension in the direction of the ramp running slope.

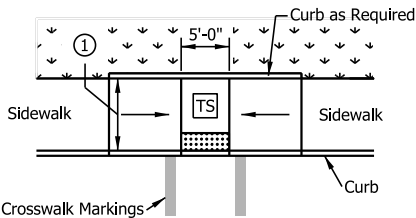

MIDBLOCK CROSSING CURB RAMP

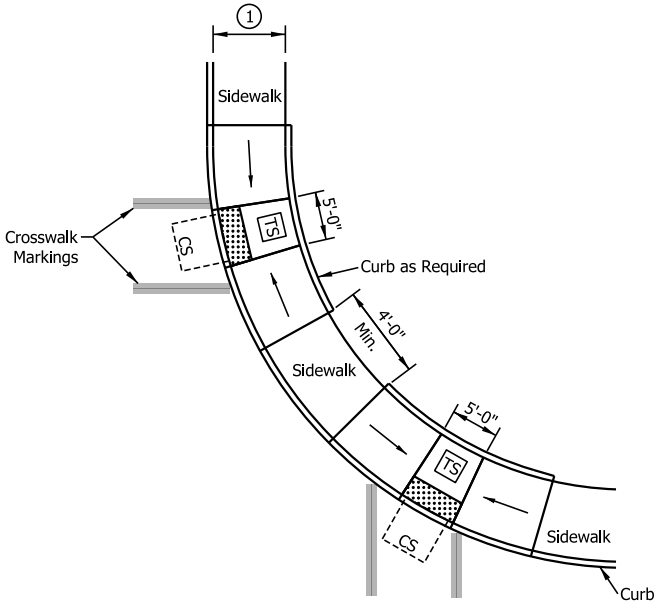


PAIRED PARALLEL CURB RAMPS ALONG LARGE RADIUS

LEGEND:

- Buffer or Other Non-Walkable Surface
- Ramp
- Detectable Warning Surface
- Turning Space
- Clear Space

INDIANA DEPARTMENT OF TRANSPORTATION									
PAIRED PARALLEL CURB RAMPS AND MIDBLOCK CROSSING CURB RAMP TYPICAL PLACEMENT									
SEPTEMBER 2016									
STANDARD DRAWING NO.	E 604-SWCR-07								
	<table style="width: 100%; border: none;"> <tr> <td style="border: none;"><i>/s/ Elizabeth W. Phillips</i></td> <td style="border: none; text-align: right;">03/15/16</td> </tr> <tr> <td style="border: none;">DESIGN STANDARDS ENGINEER</td> <td style="border: none; text-align: right;">DATE</td> </tr> <tr> <td style="border: none;"><i>/s/ Mark A. Miller</i></td> <td style="border: none; text-align: right;">03/18/16</td> </tr> <tr> <td style="border: none;">CHIEF ENGINEER</td> <td style="border: none; text-align: right;">DATE</td> </tr> </table>	<i>/s/ Elizabeth W. Phillips</i>	03/15/16	DESIGN STANDARDS ENGINEER	DATE	<i>/s/ Mark A. Miller</i>	03/18/16	CHIEF ENGINEER	DATE
<i>/s/ Elizabeth W. Phillips</i>	03/15/16								
DESIGN STANDARDS ENGINEER	DATE								
<i>/s/ Mark A. Miller</i>	03/18/16								
CHIEF ENGINEER	DATE								

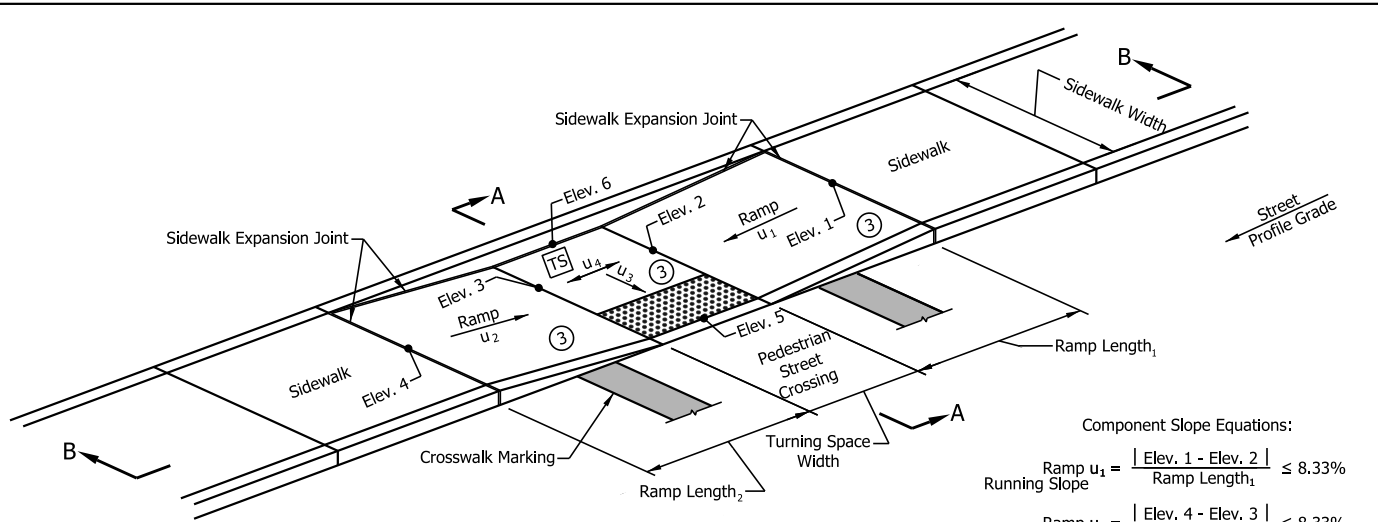


Component Slope Equations:

$$\text{Ramp } u_1 = \frac{|\text{Elev. 1} - \text{Elev. 2}|}{\text{Ramp Length}_1} \leq 8.33\%$$


$$\text{Ramp } u_2 = \frac{|\text{Elev. 4} - \text{Elev. 3}|}{\text{Ramp Length}_2} \leq 8.33\%$$

$$\text{Turning Space } u_3 = \frac{|\text{Elev. 6} - \text{Elev. 5}|}{\text{Sidewalk Width}} \leq 2.00\%$$

$$\text{Turning Space } u_4 = \frac{|\text{Elev. 2} - \text{Elev. 3}|}{\text{Turning Space Width}} \leq 2.00\% \text{ (5)}$$

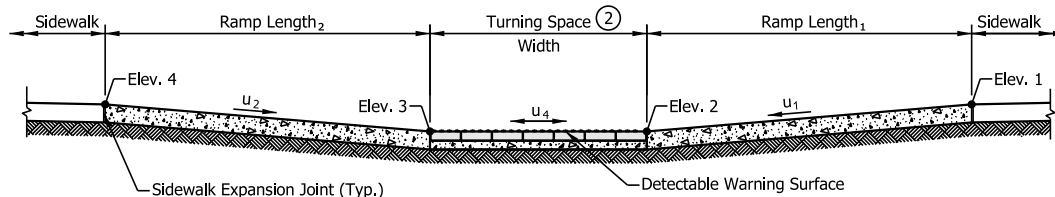

SECTION B-B

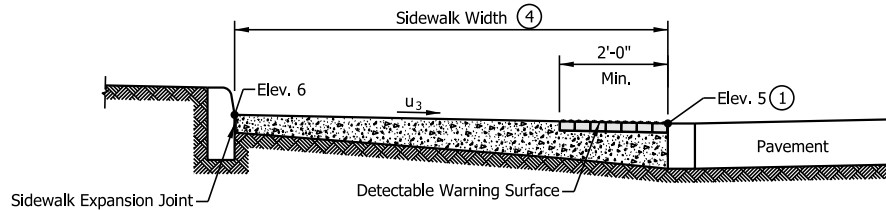

SECTION A-A

NOTES:

- ① The bottom edge of the turning space and top of curb shall be flush with the edge of adjacent pavement and gutter line.
- ② The turning space shall have a minimum clear dimension of 4 ft x 4 ft and a running slope of 2.00% maximum. Where the turning space is constrained at the back of the sidewalk, the minimum clear dimension shall be 4 ft x 5 ft, with the 5-ft dimension in the direction of the ramp running slope.
- ③ Curb ramp surface shall be coarse broomed transverse to the running slope.
- ④ Where there is no buffer between the sidewalk and curb, the preferred minimum sidewalk width is 6 ft. Where a buffer is placed between the sidewalk and curb, the preferred minimum sidewalk width is 5 ft. See Standard Drawing Series E 604-SDWK for sidewalk details.
- ⑤ See Standard Drawing E 604-SWCR-01 for cross slope exceptions.
6. See Standard Drawing E 604-SWCR-12, -13, and -14 for Detectable Warning Surface placement, configuration, and details.
7. See Standard Drawing E 604-CCSJ-01 for sidewalk expansion joint details.

LEGEND:


- Ramp
- Detectable Warning Surface
- Turning Space

INDIANA DEPARTMENT OF TRANSPORTATION

PARALLEL CURB RAMP
COMPONENT DETAILS


SEPTEMBER 2016

STANDARD DRAWING NO. E 604-SWCR-08




/s/ Elizabeth W. Phillips 03/15/16
DESIGN STANDARDS ENGINEER DATE


/s/ Mark A. Miller 03/18/16
CHIEF ENGINEER DATE

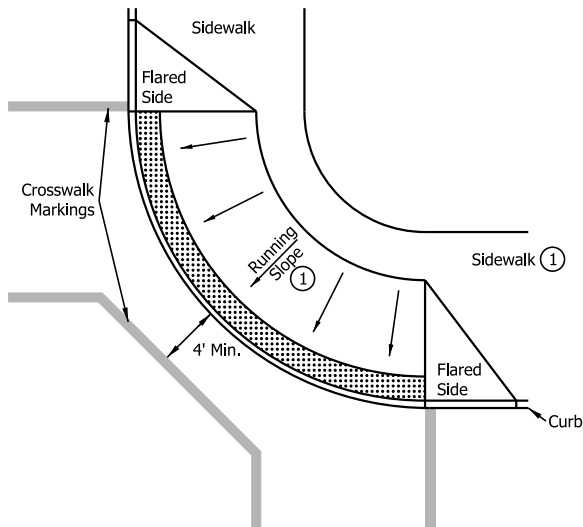


**BLENDING TRANSITION CURB RAMP
WITH RUNNING SLOPE > 2.00%**

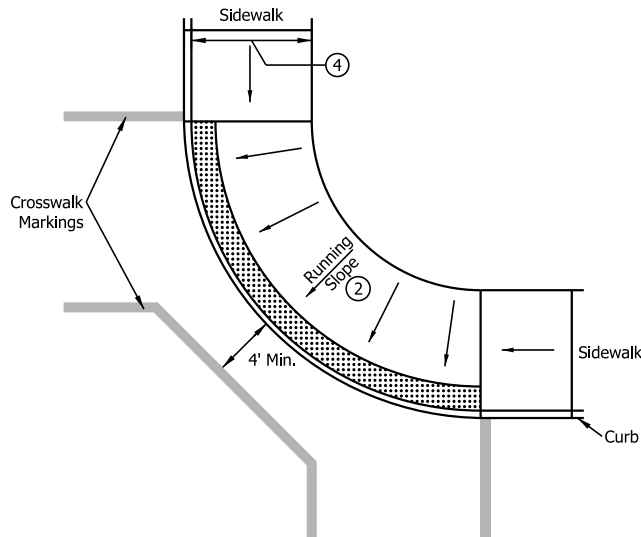

**BLENDING TRANSITION CURB RAMP
WITH RUNNING SLOPE ≤ 2.00%**

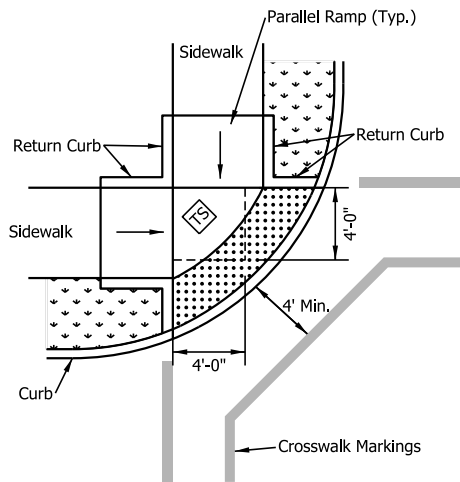

DEPRESSED CORNER CURB RAMP

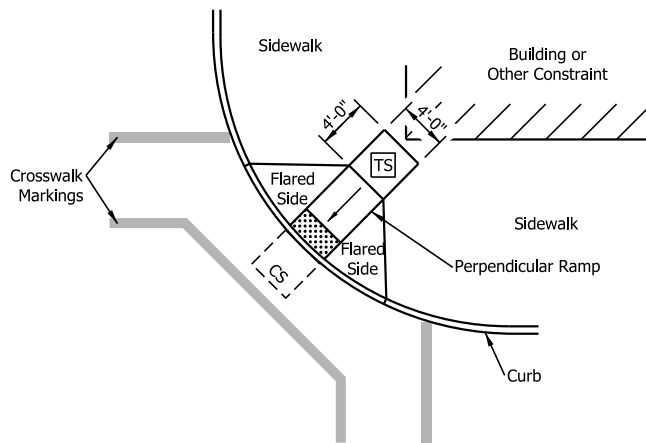

DIAGONAL CURB RAMP ③

NOTES:

- ① Where the running slope is greater than 2.00%, a 4-ft minimum sidewalk shall continue behind the blended transition. The running slope shall not exceed 5.00%.
- ② Where the running slope is less than or equal to 2.00% a 4-ft minimum sidewalk is not required behind the blended transition.
- ③ A diagonal curb ramp shall not be used for new construction. For an alteration project, a diagonal curb ramp shall be used only where existing physical conditions prevent paired curb ramps, a blended transition curb ramp, or a depressed corner curb ramp from being provided.
- ④ Where there is no buffer between the sidewalk and curb the preferred minimum sidewalk width is 6 ft. Where a buffer is placed between the sidewalk and curb, the preferred minimum sidewalk width is 5 ft. See Standard Drawing Series E 604-SDWK for sidewalk details.

LEGEND:


- Buffer or Other Non-Walkable Surface
- Ramp
- Detectable Warning Surface
- Turning Space
- Clear Space

INDIANA DEPARTMENT OF TRANSPORTATION

BLENDING TRANSITION CURB RAMP,
DEPRESSED CURB RAMP AND DIAGONAL
CURB RAMP TYPICAL PLACEMENT


SEPTEMBER 2016

STANDARD DRAWING NO. E 604-SWCR-09



/s/ Elizabeth W. Phillips 03/15/16
DESIGN STANDARDS ENGINEER DATE

/s/ Mark A. Miller 03/18/16
CHIEF ENGINEER DATE

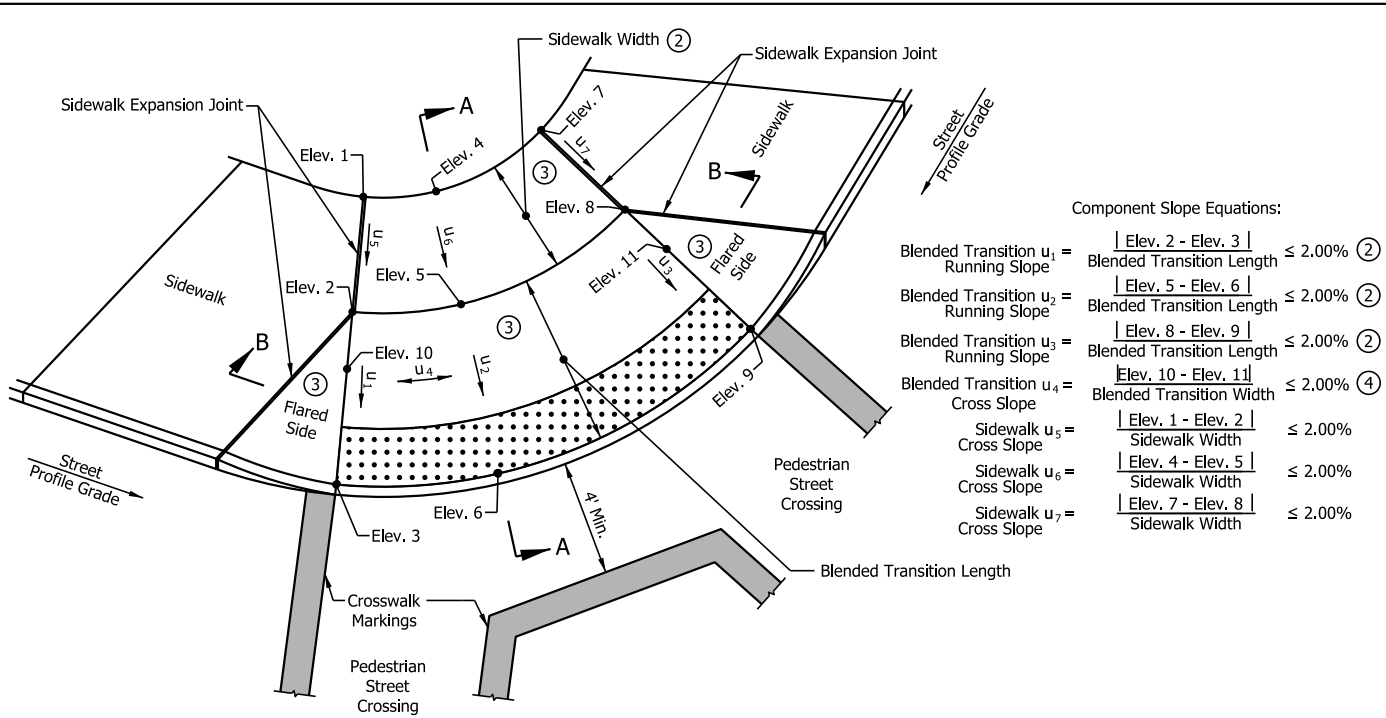



Component Slope Equations:

$$\begin{aligned} \text{Blended Transition } u_1 = \text{Running Slope} &= \frac{|\text{Elev. 2} - \text{Elev. 3}|}{\text{Blended Transition Length}} \leq 2.00\% \text{ (2)} \\ \text{Blended Transition } u_2 = \text{Running Slope} &= \frac{|\text{Elev. 5} - \text{Elev. 6}|}{\text{Blended Transition Length}} \leq 2.00\% \text{ (2)} \\ \text{Blended Transition } u_3 = \text{Running Slope} &= \frac{|\text{Elev. 8} - \text{Elev. 9}|}{\text{Blended Transition Length}} \leq 2.00\% \text{ (2)} \\ \text{Blended Transition } u_4 = \text{Cross Slope} &= \frac{|\text{Elev. 10} - \text{Elev. 11}|}{\text{Blended Transition Width}} \leq 2.00\% \text{ (4)} \\ \text{Sidewalk } u_5 = \text{Cross Slope} &= \frac{|\text{Elev. 1} - \text{Elev. 2}|}{\text{Sidewalk Width}} \leq 2.00\% \\ \text{Sidewalk } u_6 = \text{Cross Slope} &= \frac{|\text{Elev. 4} - \text{Elev. 5}|}{\text{Sidewalk Width}} \leq 2.00\% \\ \text{Sidewalk } u_7 = \text{Cross Slope} &= \frac{|\text{Elev. 7} - \text{Elev. 8}|}{\text{Sidewalk Width}} \leq 2.00\% \end{aligned}$$


NOTES:

- ① The bottom edge of the blended transition and top of curb shall be flush with the edge of adjacent pavement and gutter line.
- ② Where the running slope is less than or equal to 2.00% a 4-ft minimum sidewalk is not required, behind the blended transition. Where the running slope is greater than 2.00%, a 4-ft minimum sidewalk shall continue behind the blended transition and the running slope shall not exceed 5.00%.
- ③ Curb ramp surface shall be coarse broomed transverse to the running slope.
- ④ See Standard Drawing E 604-SWCR-01 for cross slope exceptions.
5. See Standard Drawing E 604-SWCR-12, -13, and -14 for Detectable Warning Surface placement, configuration, and details.
6. See Standard Drawing E 604-CCSJ-01 for sidewalk expansion joint details.

LEGEND:

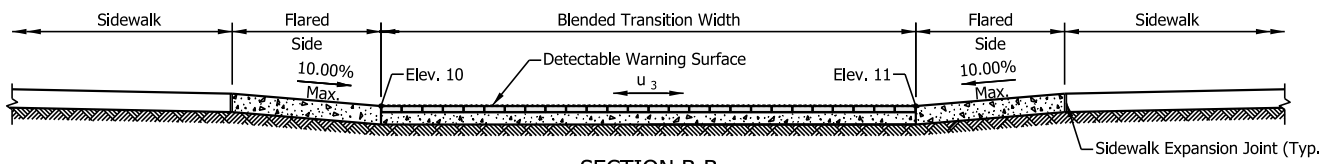


SECTION B-B



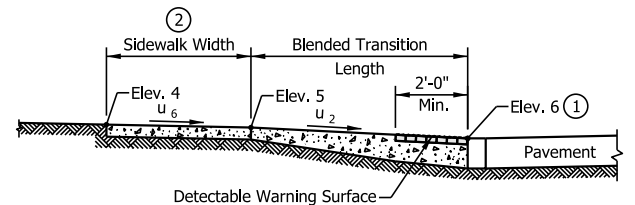


SECTION A-A


INDIANA DEPARTMENT OF TRANSPORTATION											
BLENDED TRANSITION CURB RAMP COMPONENT DETAILS											
SEPTEMBER 2016											
STANDARD DRAWING NO.	E 604-SWCR-10										
	<table style="width: 100%; border: none;"> <tr> <td style="border: none;">/s/ Elizabeth W. Phillips</td> <td style="border: none;">03/15/16</td> </tr> <tr> <td style="border: none;">DESIGN STANDARDS ENGINEER</td> <td style="border: none;">DATE</td> </tr> <tr> <td colspan="2" style="border: none;"> </td> </tr> <tr> <td style="border: none;">/s/ Mark A. Miller</td> <td style="border: none;">03/18/16</td> </tr> <tr> <td style="border: none;">CHIEF ENGINEER</td> <td style="border: none;">DATE</td> </tr> </table>	/s/ Elizabeth W. Phillips	03/15/16	DESIGN STANDARDS ENGINEER	DATE			/s/ Mark A. Miller	03/18/16	CHIEF ENGINEER	DATE
/s/ Elizabeth W. Phillips	03/15/16										
DESIGN STANDARDS ENGINEER	DATE										
/s/ Mark A. Miller	03/18/16										
CHIEF ENGINEER	DATE										

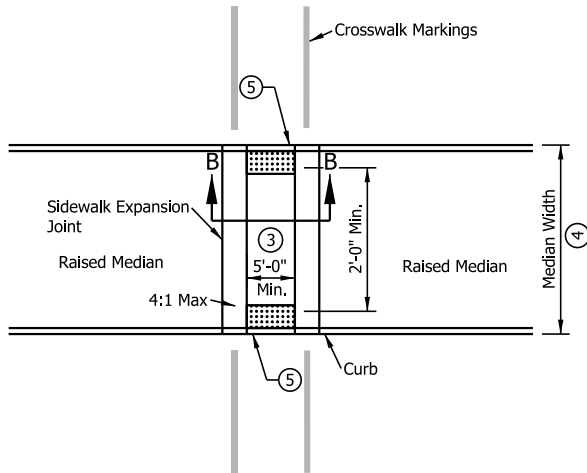

MEDIAN CUT-THROUGH WITH TAPERED CURB

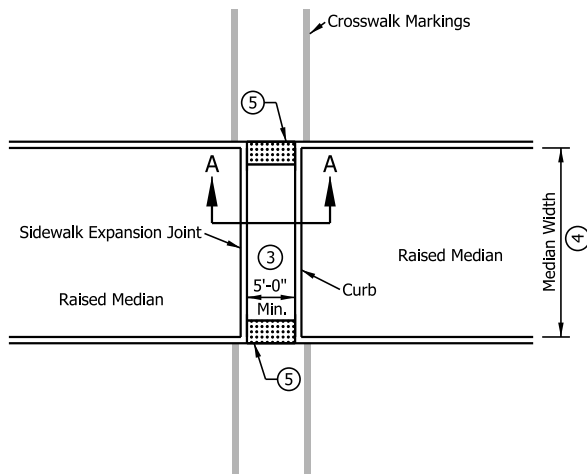

MEDIAN CUT-THROUGH WITH CURB

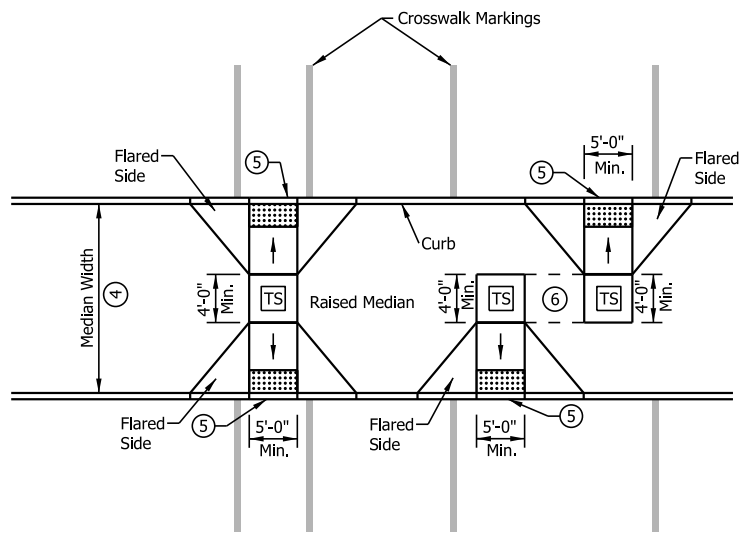

MEDIAN PERPENDICULAR CURB RAMPS


NOTES:

1. The minimum width of a median cut-through and median perpendicular curb ramp shall be 5 ft.
2. Where in-line or offset perpendicular curb ramps are used within a median, the turning space shall have a minimum clear dimension of 4 ft x 5 ft.
3. Where a median cut through is used the running slope shall be 2.00% maximum.
4. Where median width is less than 6 ft, detectable warning surfaces shall not be placed.
5. The bottom edge of the median cut-through or median perpendicular curb ramp and the top of curb shall be flush with the edge of adjacent pavement gutter line.
6. Walkable Surface. The cross slope shall be 2.00% maximum.
7. See Standard Drawing E 604-SWCR-01 for cross slope exceptions.
8. See Standard Drawing E 604-SWCR-12, -13, and -14 for Detectable Warning Surface placement, configuration, and details.
9. See Standard Drawing E 604-CCSJ-01 for sidewalk expansion joint details.


LEGEND:

- Ramp
- Detectable Warning Surface
- Turning Space


INDIANA DEPARTMENT OF TRANSPORTATION	
MEDIAN CUT-THROUGH AND MEDIAN PERPENDICULAR CURB RAMP TYPICAL PLACEMENT	
SEPTEMBER 2016	
STANDARD DRAWING NO.	E 604-SWCR-11
	/s/ Elizabeth W. Phillips 03/15/16 DESIGN STANDARDS ENGINEER DATE
	/s/ Mark A. Miller 03/18/16 CHIEF ENGINEER DATE

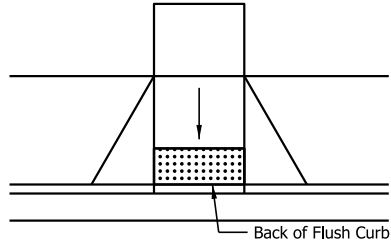



PERPENDICULAR CURB RAMP ③

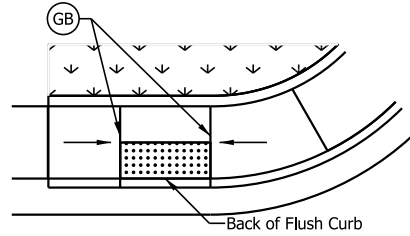


PARALLEL CURB RAMP ④

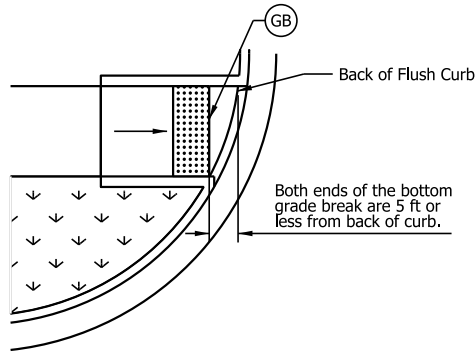

ONE-WAY DIRECTIONAL PERPENDICULAR CURB RAMPS ③

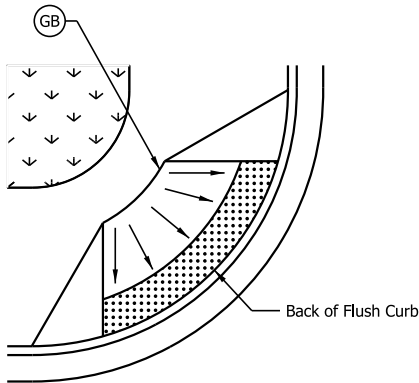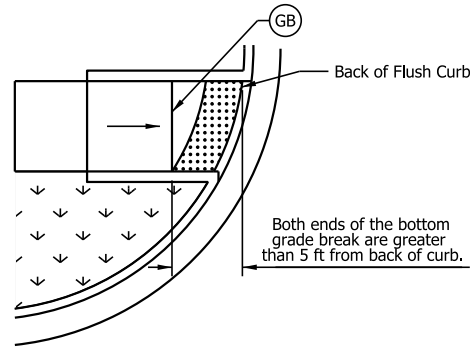

BLENDED TRANSITION CURB RAMP ⑤

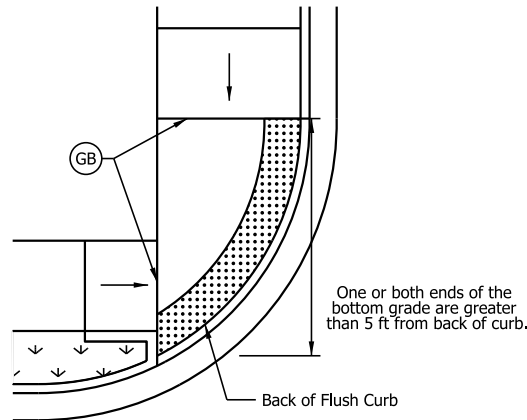

DEPRESSED CORNER CURB RAMP ⑤

NOTES:

1. A detectable warning surface shall be placed at each street, highway, or railroad crossing. See Standard Drawing E 604-SDWK-03 for a detectable warning surface placement at a sidewalk driveway crossing.
2. The detectable warning surface shall extend a minimum of 2 ft in the direction of pedestrian travel and extend the full width as shown. The detectable warning surface shall not be placed across a grade break.
- ③ Where the of the bottom grade break on a perpendicular curb ramp is 5 ft or less from the back of curb, the detectable warning surface shall be placed on the ramp within one dome spacing of the bottom grade break. Where the bottom grade break is more than 5 ft from the back of curb, the detectable warning surface shall be placed at the back of curb.
- ④ The detectable warning surface on a parallel curb shall be placed on the turning space at the flush transition between the street and turning space at the back of curb.
- ⑤ The detectable warning surface on a blended transition or depressed corner curb ramp shall be placed at the back of curb.
6. See Standard Drawing E 604-SWCR-14 where a concrete border is used as an edge restraint for a brick detectable warning surface.

LEGEND:


- Buffer or Other Non-Walkable Surface
- Detectable Warning Surface
- Ramp
- Grade Break

INDIANA DEPARTMENT OF TRANSPORTATION

DETECTABLE WARNING SURFACE
PLACEMENT AND CONFIGURATION


SEPTEMBER 2016

STANDARD DRAWING NO. E 604-SWCR-12




/s/ Elizabeth W. Phillips 03/15/16
DESIGN STANDARDS ENGINEER DATE


/s/ Mark A. Miller 03/18/16
CHIEF ENGINEER DATE

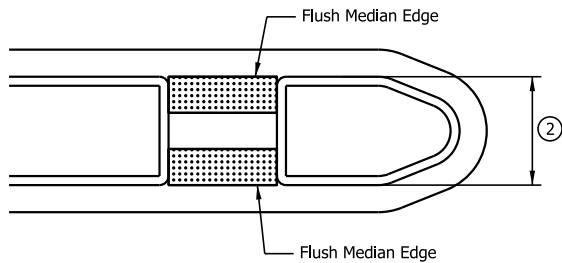

MEDIAN CUT-THROUGH

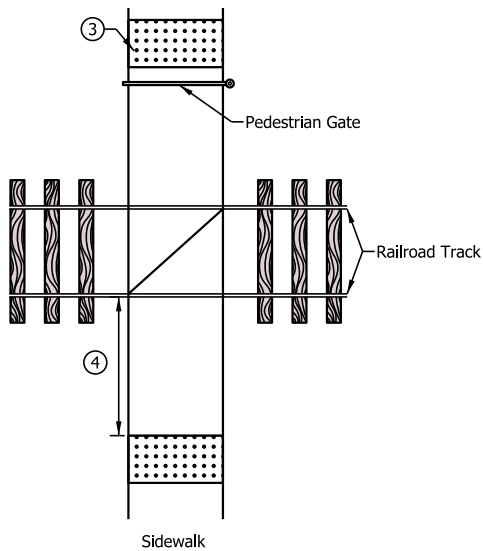

RAILROAD CROSSING

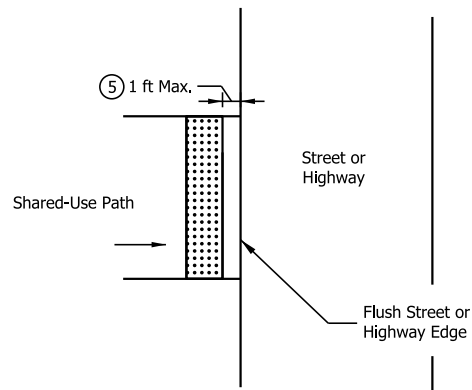

SHARED-USE PATH

NOTES:

1. The detectable warning surface shall extend a minimum of 2 ft in the direction of pedestrian travel and extend the full width as shown. The detectable warning surface shall not be placed across a grade break.
2. The detectable warning surface on a median cut-through shall be placed a the flush transition between the street and median cut-through. Where a median is less than 6 ft, a detectable warning surface shall not be placed.
3. Where a pedestrian gate is provided at a railroad crossing, the detectable warning surface shall be placed on the side of the gate opposite the railroad crossing.
4. The edge of the detectable warning surface nearest to the railroad crossing shall be placed 6 ft minimum and 15 ft maximum from the centerline of the nearest rail.
5. Where a shared-use path intersects a street or highway, the detectable warning surface shall be placed on the shared-use path within 1 ft of the street or highway edge.
6. See Standard Drawing E 604-SWCR-14 where a concrete border is used as an edge restraint for a brick detectable warning surface.

LEGEND:


- Buffer or Other Non-Walkable Surface
- Detectable Warning Surface
- Ramp
- Grade Break

INDIANA DEPARTMENT OF TRANSPORTATION

DETECTABLE WARNING SURFACE
PLACEMENT AND CONFIGURATION


SEPTEMBER 2016

STANDARD DRAWING NO. E 604-SWCR-13




/s/ Elizabeth W. Phillips 03/15/16
DESIGN STANDARDS ENGINEER DATE



/s/ Mark A. Miller 03/18/16
CHIEF ENGINEER DATE

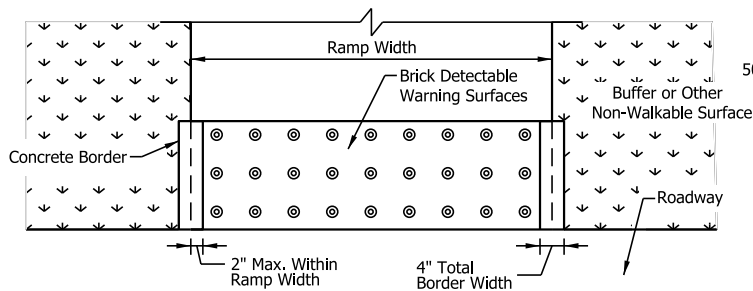

BRICK DETECTABLE WARNING SURFACE WITH CONCRETE BORDER ⑥ ⑦

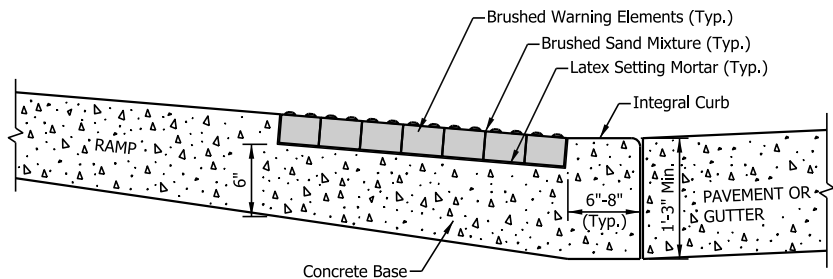


TYPICAL RAMP AND BRICK SURFACE CONSTRUCTION DETAIL

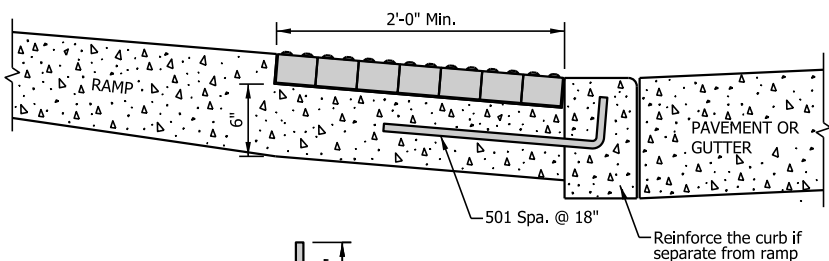


501 x 1'-10"


ALTERNATE CURB CONSTRUCTION

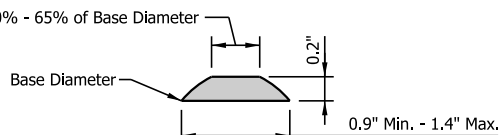

SECTION A-A

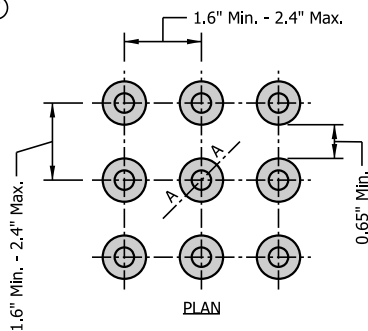

TRUNCATED DOMES

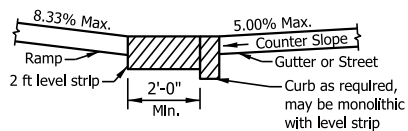

CHANGE OF GRADE > 11% ⑤

NOTES:


1. Detectable warning surface shall consist of truncated domes and shall be aligned in a square or radial grid pattern. Where truncated domes are arrayed radially, they may differ in diameter and center-to-center spacing within the ranges specified.
2. The detectable warning surface shall be manufactured to fit the radii. Field cutting shall not alter the truncated dome spacing between the adjacent panels outside of the allowable range.
3. The detectable warning surface shall contrast visually with adjacent surfaces, either light-on-dark or dark-on-light.
4. The detectable warning surface shall extend a minimum of 2 ft in the direction of pedestrian travel and extend the full width as shown. The detectable warning surface shall not be placed across a grade break.
- ⑤ The maximum counter slope of the gutter or street at the bottom of the ramp shall be 5.00%. Where the algebraic difference between the running slope and the counter slope exceeds 11%, a 2-ft minimum level strip should be provided at the bottom of the ramp.
- ⑥ Where concrete border is used for forming, the border shall be cast monolithically with the curb ramp concrete. The concrete border shall not exceed 2 in. within the ramp width.
- ⑦ Where forming other than a concrete border is used, the edge restraint shall not encroach upon the ramp width.

INDIANA DEPARTMENT OF TRANSPORTATION

DETECTABLE WARNING SURFACE DETAILS

SEPTEMBER 2016

STANDARD DRAWING NO. E 604-SWCR-14



/s/ Elizabeth W. Phillips 03/15/16
DESIGN STANDARDS ENGINEER DATE

/s/ Mark A. Miller 03/18/16
CHIEF ENGINEER DATE