





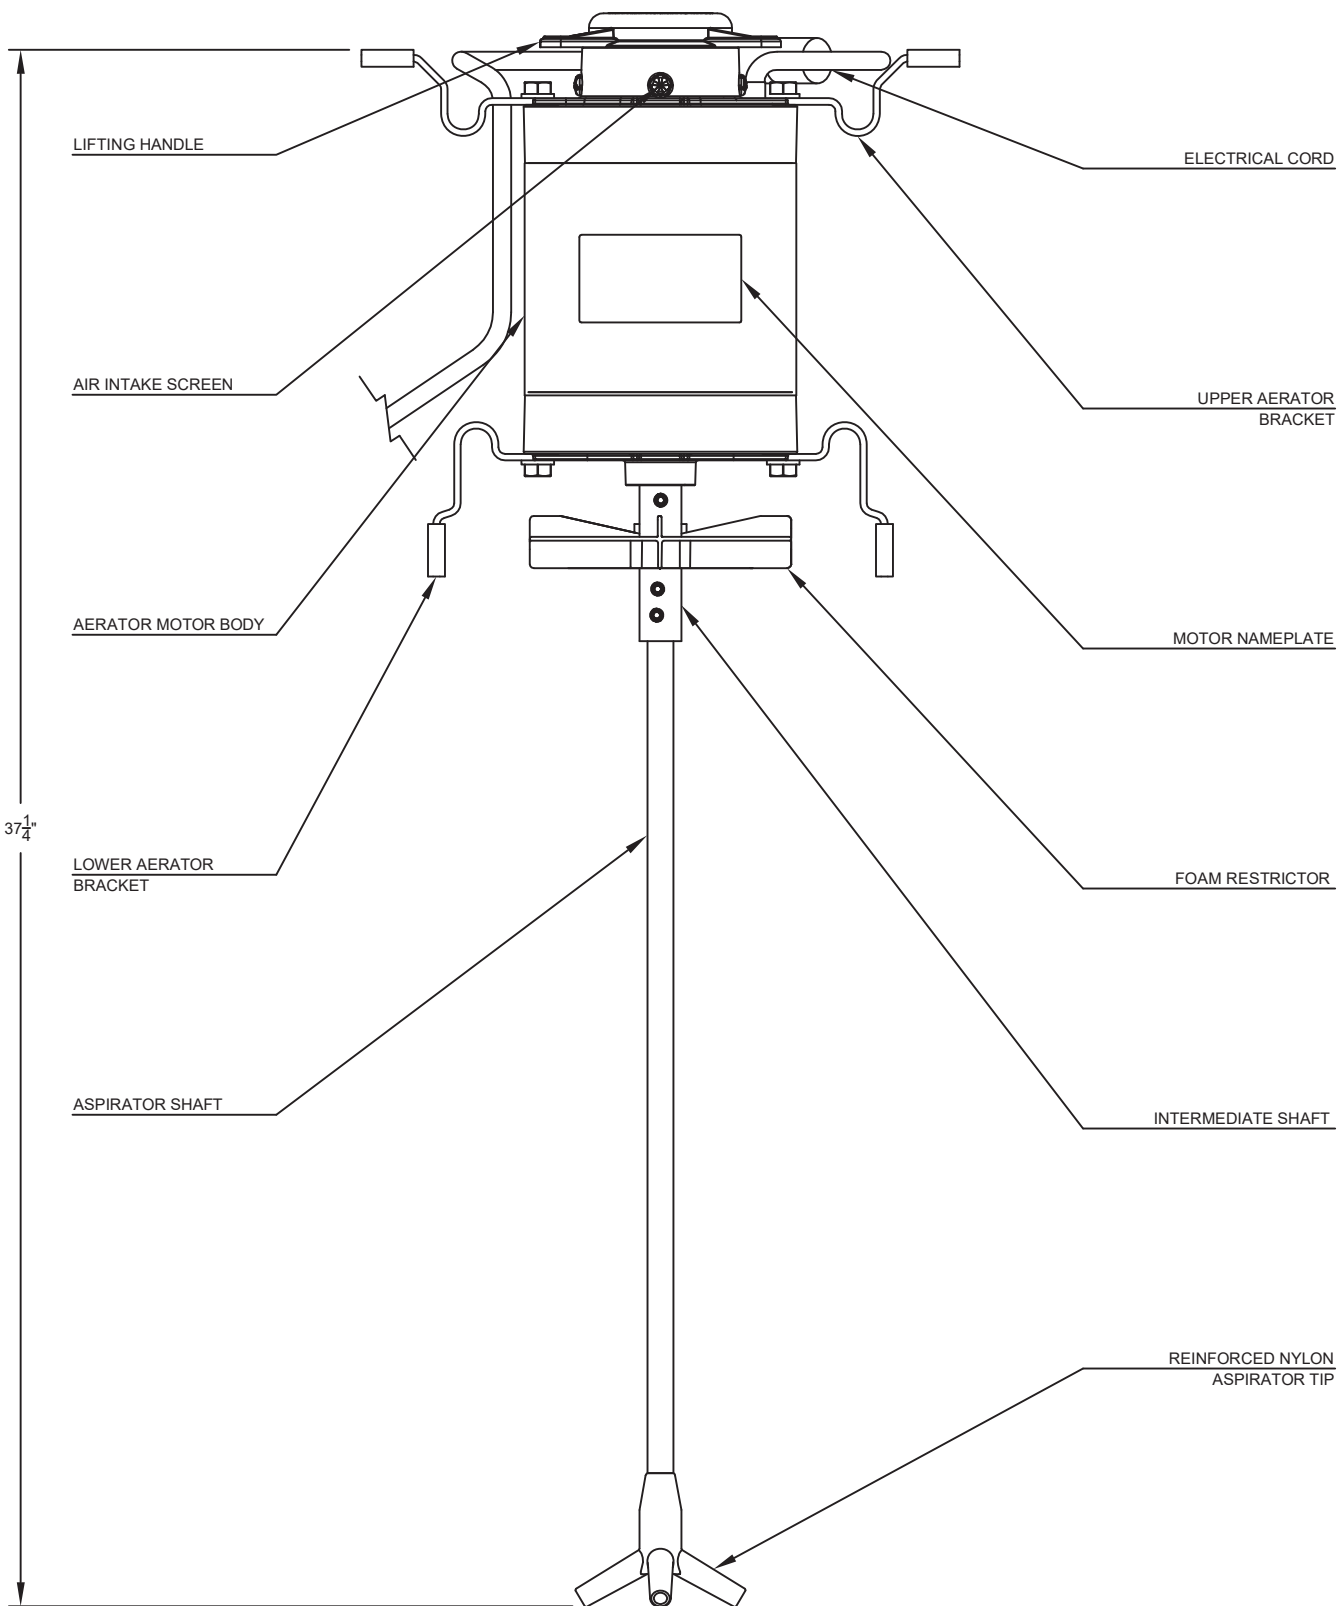


PART NUMBER:	
U.S. AND FOREIGN PATENTS PENDING	<i>norweco</i> MODEL 225L AERATOR ASSEMBLY
© MMXXIV	REVISION DATE: 10-01-2024 DESIGNED BY: JMM DATE: 10-01-2024 CHECKED BY: NTS APPROVED BY: CLB
PC-5-7730	

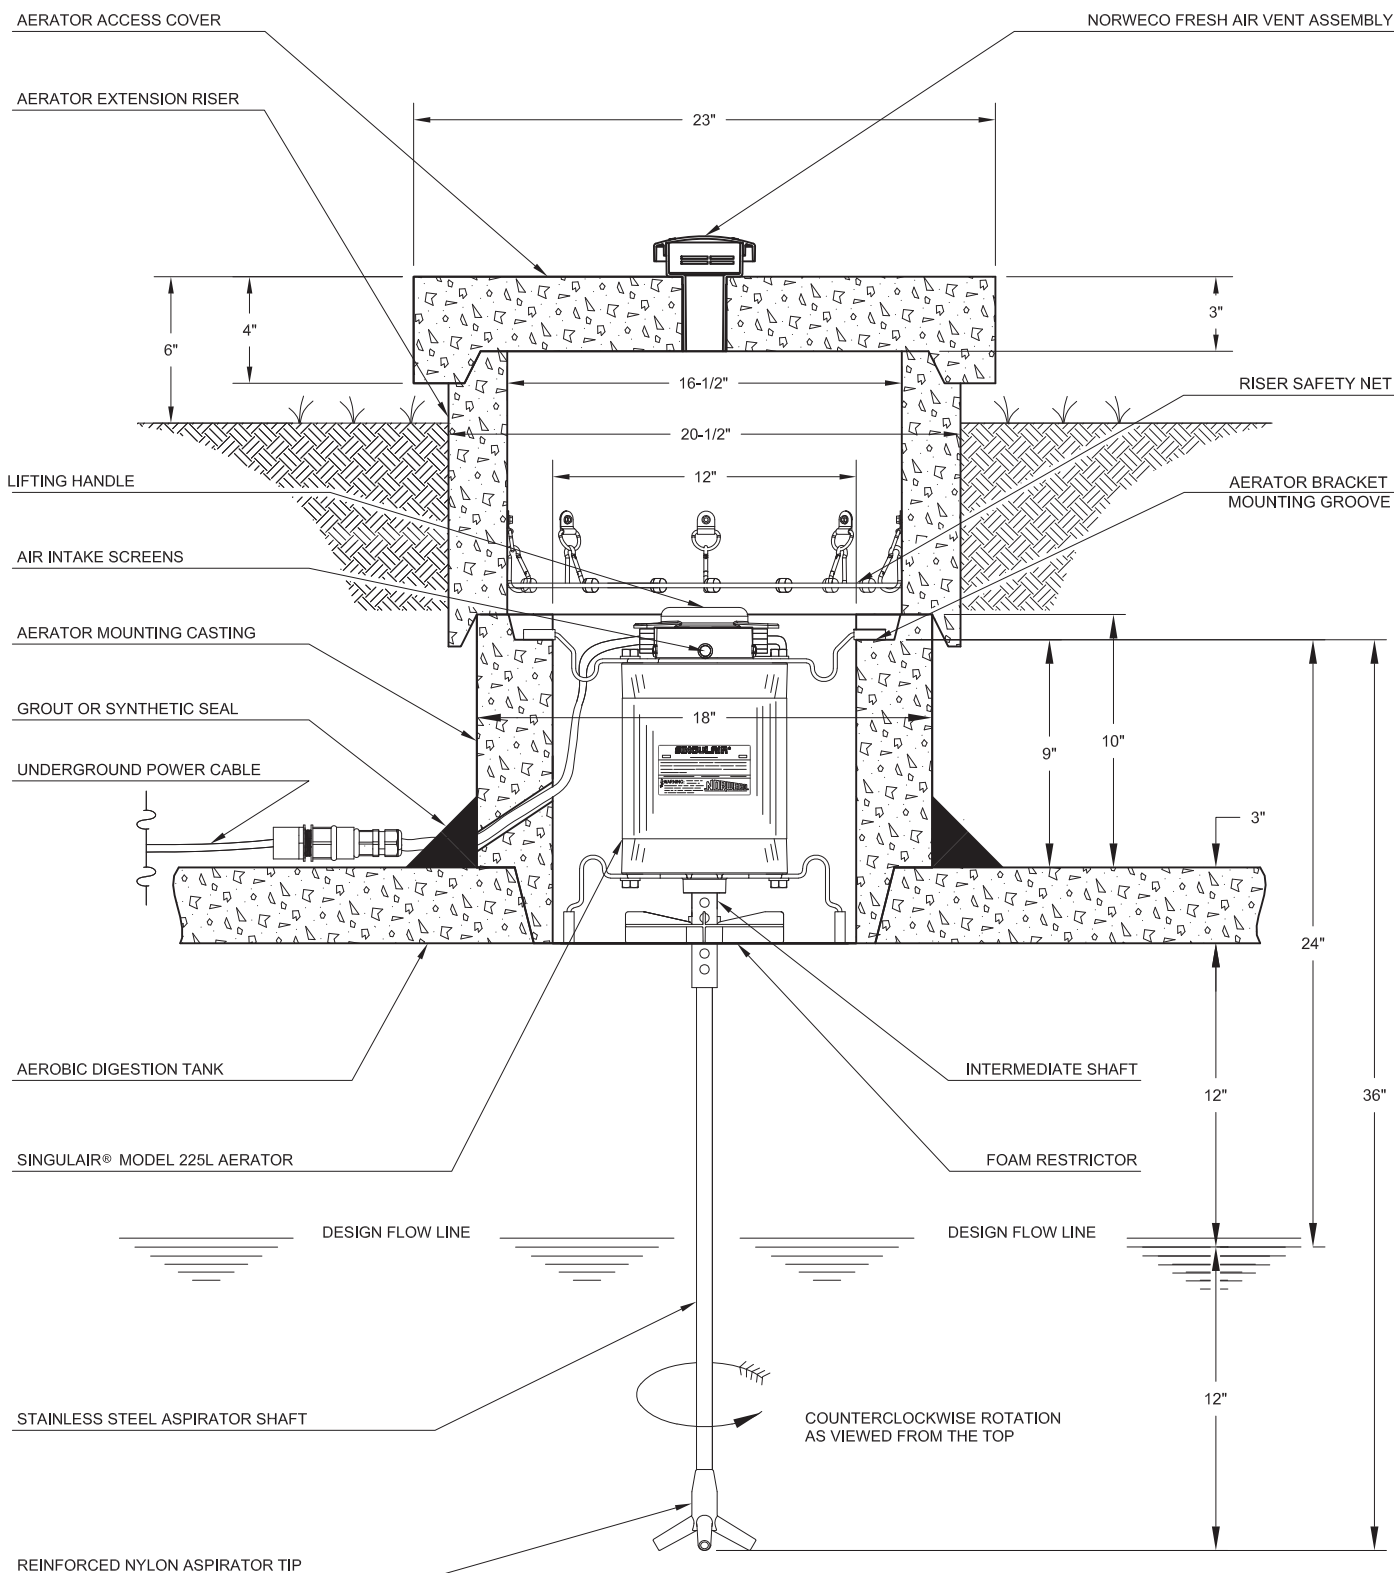

GENERAL NOTES:

1. UNDERGROUND POWER SUPPLY MUST BE WIRED INTO AN APPROVED SINGLAIR® CONTROL CENTER.
2. SINGLAIR® CONTROL CENTER MUST BE WIRED INTO A SEPARATE 10 AMP CIRCUIT BREAKER AT MAIN ELECTRICAL SERVICE PANEL IN THE FACILITY.
3. AERATOR AND AERATOR CONTROL CENTER MUST BE PROPERLY GROUNDED.
4. THE LOCAL, LICENSED NORWECO DISTRIBUTOR WILL PLACE THE AERATOR INTO SERVICE.

U.S. AND FOREIGN PATENTS PENDING	norweco		REVISION DATE	REVISION
	MODEL 225L SINGLAIR® AERATOR MOUNTING AND INSTALLATION DETAIL		DESIGNED BY	CLB
			DATE	2-26-2025
			SCALE	NTS
© MMXXV	THIS DRAWING IS THE PROPERTY OF NORWECO. IT IS TO BE USED FOR THE EXCLUSIVE PURPOSE OF THE PROJECT AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF NORWECO.		PC-5-7607-IN	

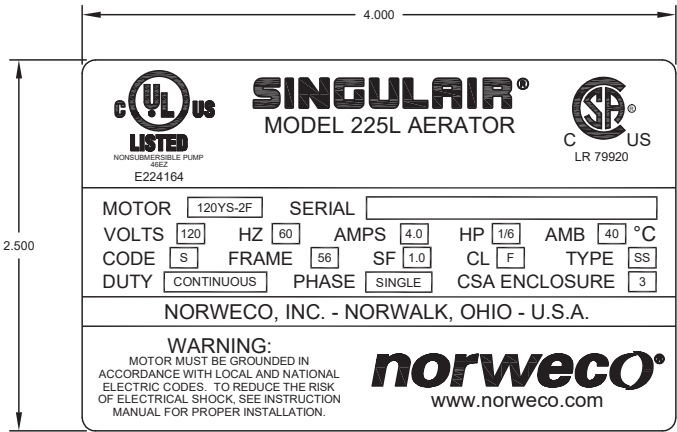

GENERAL NOTES:

- 1. ALL DIMENSIONS ARE IN INCHES.
- 2. MATERIAL: UL SFT-00.

PART NUMBER:			
U.S. AND FOREIGN PATENTS PENDING	norweco	DESIGNED BY	REVISED
		DESIGNED BY	CLB
		DESIGNED BY	JMM
		DATE	9-30-2024
© MMXXIV	MODEL 225L AERATOR MOTOR NAMEPLATE	SCALE	1:1
		PC-7-7526	